



# Current/Voltage Converter KFD0-CC-Ex1

- 1-channel isolated barrier
- 24 V DC supply (loop powered)
- Current or voltage input
- Output: 4 ... 20 mA
- Potentiometer or DIP switch selectable ranges
- Line fault detection (LFD)



## Function


This isolated barrier is used for intrinsic safety applications. It converts a 2-wire voltage or current in the hazardous area to a 4 mA ... 20 mA signal in the safe area.

The device can be used to double signals in 20 mA measurement circuits due to the limited current signal input load of 50 Ω.

DIP switches and potentiometers make field calibration easy.

Since this isolator is loop-powered, use the technical data to verify that the proper voltage is available to the field devices.

## Connection

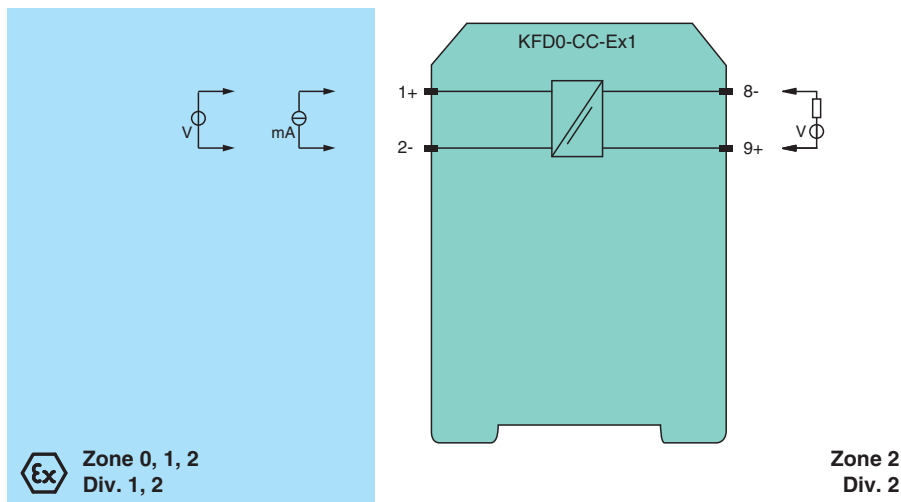

## Technical Data

General specifications	
Signal type	Analog input
<b>Supply</b>	
Rated voltage	$U_r$ 12 ... 35 V DC loop powered
Power dissipation	0.4 W
<b>Input</b>	
Connection side	field side
Connection	terminals 1+, 2-
Current range	0 ... 20 mA , load $\leq$ 50 Ω
Voltage range	0 ... 10 V , load $\geq$ 100 kΩ
<b>Output</b>	

Release date: 2022-12-07 Date of issue: 2022-12-07 Filename: 043690\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.com

USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com

PEPPERL+FUCHS

## Technical Data

Connection side	control side
Connection	terminals 9+, 8-
Load	(U -12 V) / 0.02 A
Current output	4 ... 20 mA , limited to $\leq 35$ mA
Fault signal	downscaling $\leq 3$ mA
<b>Transfer characteristics</b>	
Deviation	
After calibration	0.1 % of full-scale value
Temperature effect	span: 0.050 % of span /K ; zero point: 0.060 % of span /K
Linearization	$\leq 0.04$ % of full-scale value
Influence of supply voltage	6.5 ppm/V
Rise time	250 ms
<b>Galvanic isolation</b>	
Input/Output	safe isolation according to EN 50178, rated insulation voltage 253 V <sub>eff</sub>
<b>Indicators/settings</b>	
Control elements	DIP switch potentiometer
Configuration	via DIP switches via potentiometer
Labeling	space for labeling at the front
<b>Directive conformity</b>	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1:2013 (industrial locations)
<b>Conformity</b>	
Galvanic isolation	EN 50178:1997
Degree of protection	IEC 60529:2001
<b>Ambient conditions</b>	
Ambient temperature	-20 ... 60 °C (-4 ... 140 °F)
<b>Mechanical specifications</b>	
Degree of protection	IP20
Connection	screw terminals
Mass	approx. 100 g
Dimensions	20 x 119 x 115 mm (0.8 x 4.7 x 4.5 inch) (W x H x D) , housing type B2
Mounting	on 35 mm DIN mounting rail acc. to EN 60715:2001
<b>Data for application in connection with hazardous areas</b>	
EU-type examination certificate	ZELM 00 ATEX 0034
Marking	⊕ II (1)GD [EEx ia] IIC
Input	EEx ia IIC
Voltage	U <sub>o</sub> 9.6 V
Current	I <sub>o</sub> 0.5 mA
Power	P <sub>o</sub> 1.1 mW linear characteristic
Output	
Maximum safe voltage	U <sub>m</sub> 60 V (Attention! The rated voltage can be lower.)
Certificate	TÜV 01 ATEX 1777 X
Marking	⊕ II 3G Ex nA II T4
Galvanic isolation	
Input/Output	safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V
Directive conformity	
Directive 2014/34/EU	EN 60079-0:2012+A11:2013 , EN 60079-11:2012 , EN 60079-15:2010
<b>International approvals</b>	
CSA approval	
Control drawing	116-0132
<b>General information</b>	

Release date: 2022-12-07 Date of issue: 2022-12-07 Filename: 043690\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

 Pepperl+Fuchs Group  
www.pepperl-fuchs.com

 USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

 Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

 Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com


 **PEPPERL+FUCHS**

**Technical Data**


Supplementary information	Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see <a href="http://www.pepperl-fuchs.com">www.pepperl-fuchs.com</a> .
---------------------------	---

**Assembly**

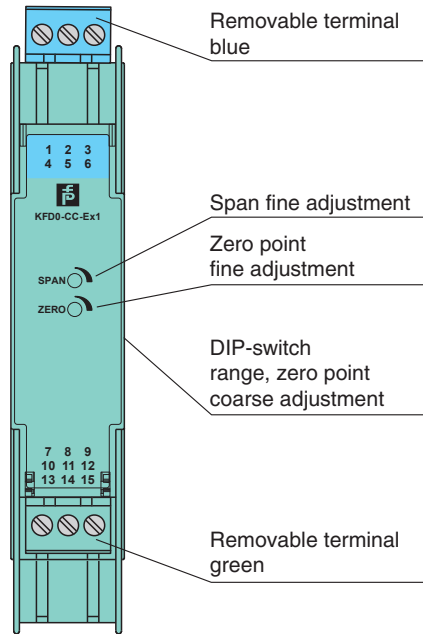


Front view



**Matching System Components**

	<b>K-DUCT-BU</b>	Profile rail, wiring comb field side, blue
---	------------------	--

**Accessories**


	<b>KF-ST-5GN</b>	Terminal block for KF modules, 3-pin screw terminal, green
	<b>KF-ST-5BU</b>	Terminal block for KF modules, 3-pin screw terminal, blue
	<b>KF-CP</b>	Red coding pins, packaging unit: 20 x 6

Release date: 2022-12-07 Date of issue: 2022-12-07 Filename: 043690\_eng.pdf


## Configuration

The device is delivered with the input signal set of 4 mA ... 20 mA.

**Example**

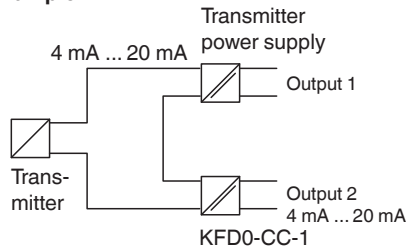

**DIP switches function**

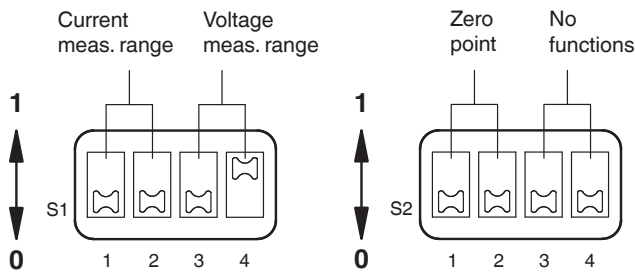

Measurement range	Switch S1 (range)				Switch S2 (zero point)			
	S1.1	S1.2	S1.3	S1.4	S2.1	S2.2	S2.3	S2.4
0 mA ... 20 mA	1	1	-	-	-	-	-	-
4 mA ... 20 mA	1	1	-	-	1	1	-	-
0 V ... 5 V	-	-	1	-	-	-	-	-
1 V ... 5 V	-	-	1	-	1	1	-	-
0 V ... 10 V	-	-	-	1	-	-	-	-
2 V ... 10 V	-	-	-	1	1	1	-	-

**Adjustment instruction (example):**

Input signal 0 mA ... 20 mA  
 Output signal 4 mA ... 20 mA

1. Set DIP switches S1.1 and S1.2 to the position 1. Set all other DIP switches to the position 0.
2. Set input to minimum value of 0 mA.
3. Adjust output, minimum zero point (4 mA).
4. Add maximum value of 20 mA.
5. Adjust output, range maximum value (20 mA)

Repeat steps 2. ... 5., until stable.

Release date: 2022-12-07 Date of issue: 2022-12-07 Filename: 043690\_eng.pdf